



Equipment Test Report
Prepared for

Ram Oppurtunities

Equipment Tested:
GE
1931461

PRECISION ELECTRIC CO.
1822 E. JACKSON ST.
PHOENIX, AZ 85034
602-252-2821
sales@precisionelectric.com

Equipment Test Report
Customer: Ram Oppurtunities

Equipment Information			
Serial #	1931461	Oper. Voltage	240
Equipment Tag	DEFAULT TAG	RPM	240
Project #	39647 ROTOR	Power	1250
Location	DEFAULT LOCATION	Power Type	Horse Power
Manufacturer	GE	New/Used	USED
		AC/DC	AC


AC Off-line Test Data			
Test Date/Time: 03/30/2016 - 10:10			
Winding Temp: 68 (F°)			
Recommended Hipot Volts: 9320			
	Volts	μAmps	Meg. Res./PI
Meg. Test			
	Volts	μAmps	
Hipot	13200	0	

Pass/Fail Results	
Surge Flashover	NO
Hipot Tripout	NO
Off-line Equip. Rating	PASS

Equipment Test Report


AC Off-line Surge - Leads 1 & 2

Recommended Voltage: 9320
Voltage Reached: 10100
Voltage Range: 10kV

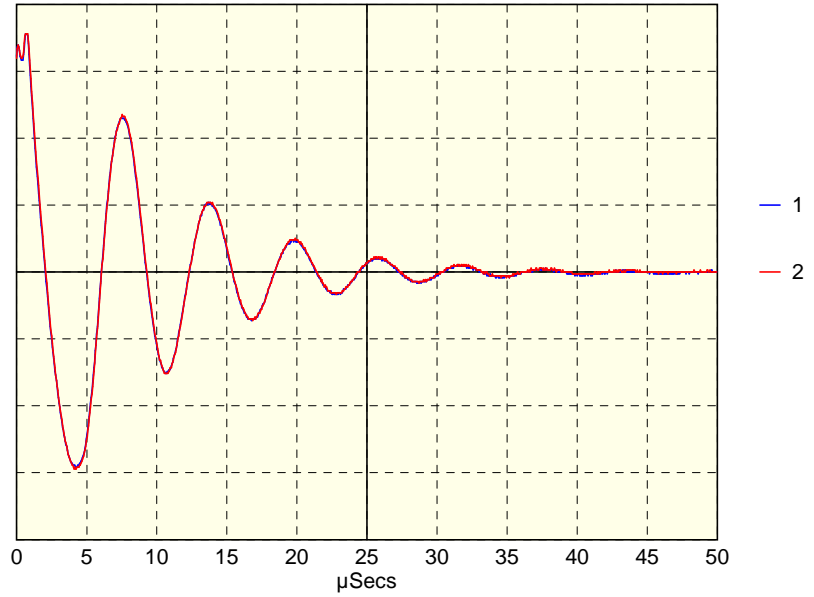


AC Off-line Surge - Leads 2 & 3

Recommended Voltage: 9320
Voltage Reached: 10100
Voltage Range: 10kV

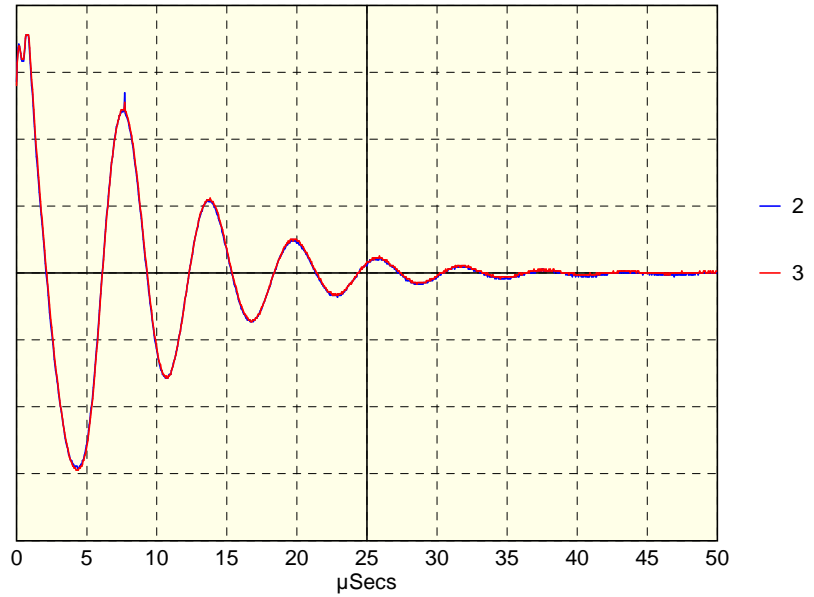

AC Off-line Surge - Leads 3 & 1

Recommended Voltage: 9320
Voltage Reached: 10100
Voltage Range: 10kV

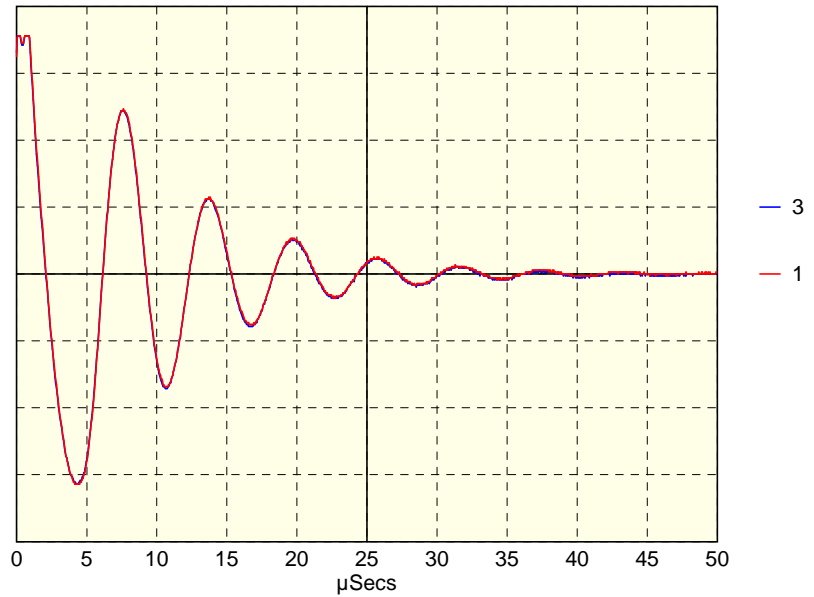



Equipment Test Report
Prepared for

Ram Oppurtunities

Equipment Tested:
GE
1931461

PRECISION ELECTRIC CO.
1822 E. JACKSON ST.
PHOENIX, AZ 85034
602-252-2821
sales@precisionelectric.com

Equipment Test Report
Customer: Ram Oppurtunities

Equipment Information			
Serial #	1931461	Oper. Voltage	240
Equipment Tag	DEFAULT TAG	RPM	240
Project #	39647 ROTOR	Power	1250
Location	DEFAULT LOCATION	Power Type	Horse Power
Manufacturer	GE	New/Used	USED
		AC/DC	AC


AC Off-line Test Data			
Test Date/Time: 03/30/2016 - 14:34			
Winding Temp: 68 (F°)			
Recommended Hipot Volts: 1480			
	Volts	μAmps	Meg. Res./PI
Meg. Test			
	Volts	μAmps	
Hipot	1900	7	

Pass/Fail Results	
Surge Flashover	NO
Hipot Tripout	NO
Off-line Equip. Rating	PASS

Equipment Test Report

AC Off-line Surge - Leads 1 & 2

Recommended Voltage: 1480
Voltage Reached: 1900
Voltage Range: 5kV

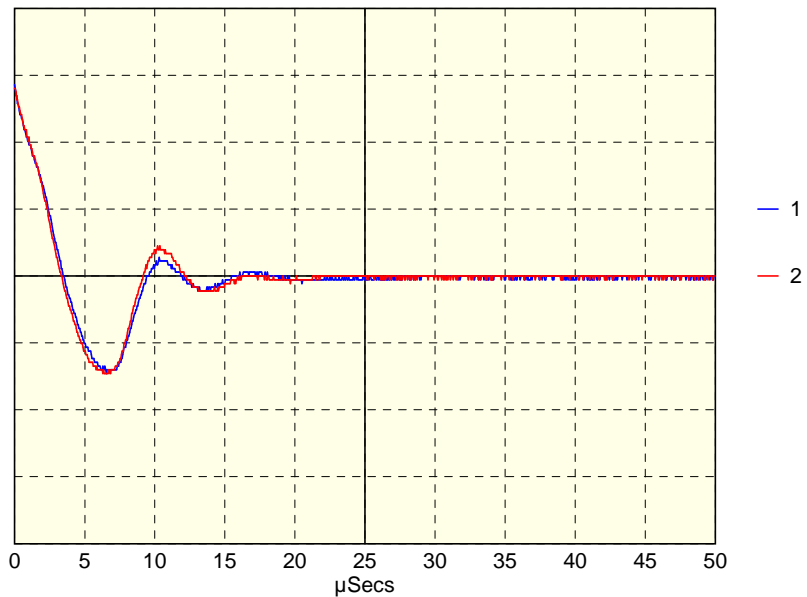

SERIAL NUMBER	931461	OPERATING VOLTAGE	4160
HORSEPOWER	1250	RPM	240
MANUFATURER	GE	FRAME	N/A
AMPERAGE	150	EXCITATION VOLTS/AMPS	240/72
MODEL	114467		

120VAC DROP VOLTAGE TEST

POLE NO.	VOLTS	POLE NO.	VOLTS	POLE NO.	VOLTS
1	3.952	11	4.021	21	3.990
2	3.964	12	4.023	22	3.989
3	4.012	13	3.993	23	3.999
4	3.992	14	3.990	24	4.037
5	4.023	15	3.974	25	4.024
6	4.054	16	3.959	26	3.998
7	4.006	17	3.997	27	4.015
8	3.986	18	4.033	28	4.036
9	3.980	19	3.988	29	4.013
10	3.995	20	4.047	30	4.057